



REACTION TO FIRE CLASSIFICATION REPORT
N° 2019/003-2

According to EN 13501-1 (2007) + A1 (2013)

(English version of classification report N°2019/003-1)

Notification by the French Government to the European Commission
under n° NB 2401
Regulation (UE) n° 305/2011

Sponsor : GERFLOR
50 Cours de la République
69627 VILLEURBANNE CEDEX
FRANCE

Product name : CREATION 30 CLIC on SILENCE PLUS 19 dB underlay

Description : Polyvinyl chloride floor coverings (EN ISO 10582 family)
(see detailed description in paragraph 2)

Date of issue : 04/01/2019

The indicated classification does not prejudge the conformity of marketed materials with the samples submitted to the tests and under no circumstances, this document should not be considered as type approval or certification of the product in the sense of the L 115-27 article of the consumption's code of the law dated June 3rd 1994.

*The reproduction of this classification report is only authorised in its integral form.
It comprises 4 pages*

1. Introduction

This classification report defines the classification assigned to the above-mentioned product (s) in accordance with the procedures given in the NF EN 13501-1 standard: September 2007 & A1 (2013).

2. Details of classified product**2.1. Product standard**

NF EN 14041 (2005):“Resilient, textile and laminate floor coverings - Essential characteristics”.

2.2. Product description

Heterogeneous polyvinyl chloride floor covering in size LVT of 1239 mm x 214 mm – 1461 mm x 241,6 mm – 728,9 mm x 390,8 mm (EN ISO 10582 family).

Use surface: 100 % PVC plastic.

Nominal mass per unit area : 7385 g/m²

Nominal total thickness : 4,50 mm

Nominal total wear layer: 0,40 mm

Underlay SILENCE PLUS 19 dB

Nominal mass per unit area: 150 g/m²

Nominal total thickness: 0,15 mm

Installation: Resilient floor covering CREATION 30 CLIC tested loose laid on underlay SILENCE PLUS 19 dB”: together tested loose laid over a wood panel particle board without flame retarded classified C_{f1-s1} with a density (680 ± 50) kg/m³ and thickness (20 ± 2) mm.

3. Test reports and tests results in support of this classification**3.1. Tests reports**

| Name of laboratory | Name of sponsor | Test report N° | Test method |
|--------------------|---|----------------|-------------------|
| C.R.E.T. | GERFLOR 50 Cours de la République 69627 VILLEURBANNE CEDEX | RL 2018/909-1 | NF EN ISO 9239-1 |
| | | RL 2018/909-2 | NF EN ISO 11925-2 |

3.2. Tests results

| Test method | Product | Number of tests | Results | |
|------------------------------|--|-----------------|------------------------------|-----------------------|
| | | | Parameters | Compliance parameters |
| NF EN ISO 11925-2 | CREATION 30 CLIC on SILENCE PLUS 19 dB underlay | 6 | Fs ≤ 150 mm | Compliant |
| Surface exposure-15 secondes | | | Ignition of the filter paper | Compliant |

| Test method | Product | Number of tests | Parameters | Results |
|------------------|---|-----------------|---|------------------------------------|
| | | | | Continuous parameters : mean value |
| NF EN ISO 9239-1 | CREATION 30 CLIC on SILENCE PLUS 19 dB underlay | 3 | Critical heat flux (kW/m ²) | 10,4 |
| | | | Smoke (% X min) | 224,9 |

4. Classification and field of application

4.1. Reference of classification

This classification has been carried out in accordance with EN 13501-1 :2007 & A1 (2013).

4.2. Classification

| Fire behaviour | | Smoke production |
|-----------------|---|------------------|
| B _{fl} | - | s1 |

Classification : B_{fl} – s1

4.3. Field of application

This classification is valid for the following end use applications :

Loose laid and glued over a wood panel particle board without flame retarded classified C_{fl}-s1, with a density ≥ 510 kg/m³ and over a fibre-cement A2_{fl} or A1_{fl} class with a density ≥ 1350 kg/m³.

This classification is valid for the following product parameters :

“CREATION 30 CLIC”

- A nominal mass per unit area of: 7385 g/m²
- A nominal thickness of : 4,50 mm
- A nominal thickness wear layer: 0,40 mm

“SILENCE PLUS 19 dB”underlay

- A nominal mass per unit area of: 150 g/m²
- A nominal thickness of : 0,15 mm

5. Limitations


This classification document does not represent type approval or certification of the product.

“The classification assigned to the product in this report is appropriate to a declaration of conformity by the manufacturer within the context of system 3 attestation of conformity and CE marking under the Construction Products Directive.

The manufacturer has made a declaration, which is held on file. This confirms that the products design requires no specific processes, procedures or stages (no addition of flame-retardants, limitation of organic content, or addition of fillers) that are aimed at enhancing the fire performance in order to obtain the classification achieved. As a consequence the manufacturer has concluded that system 3 attestation is appropriate.

The test laboratory has, therefore, played no part in sampling the product for the test, although it holds appropriate references, supplied by the manufacturer, to provide for traceability of the samples tested.”

Head of Test
David VANDIERDONCK

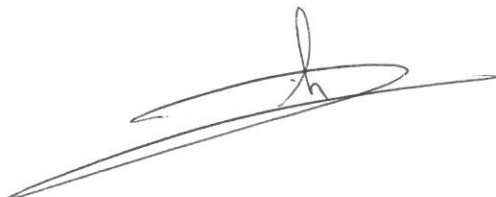

For the SARL C.R.E.T.
The Technical Director
Marc WELCOMME



End of the classification report